


FREESTANDING SPECIFICATIONS
PAGE 1 OF 2

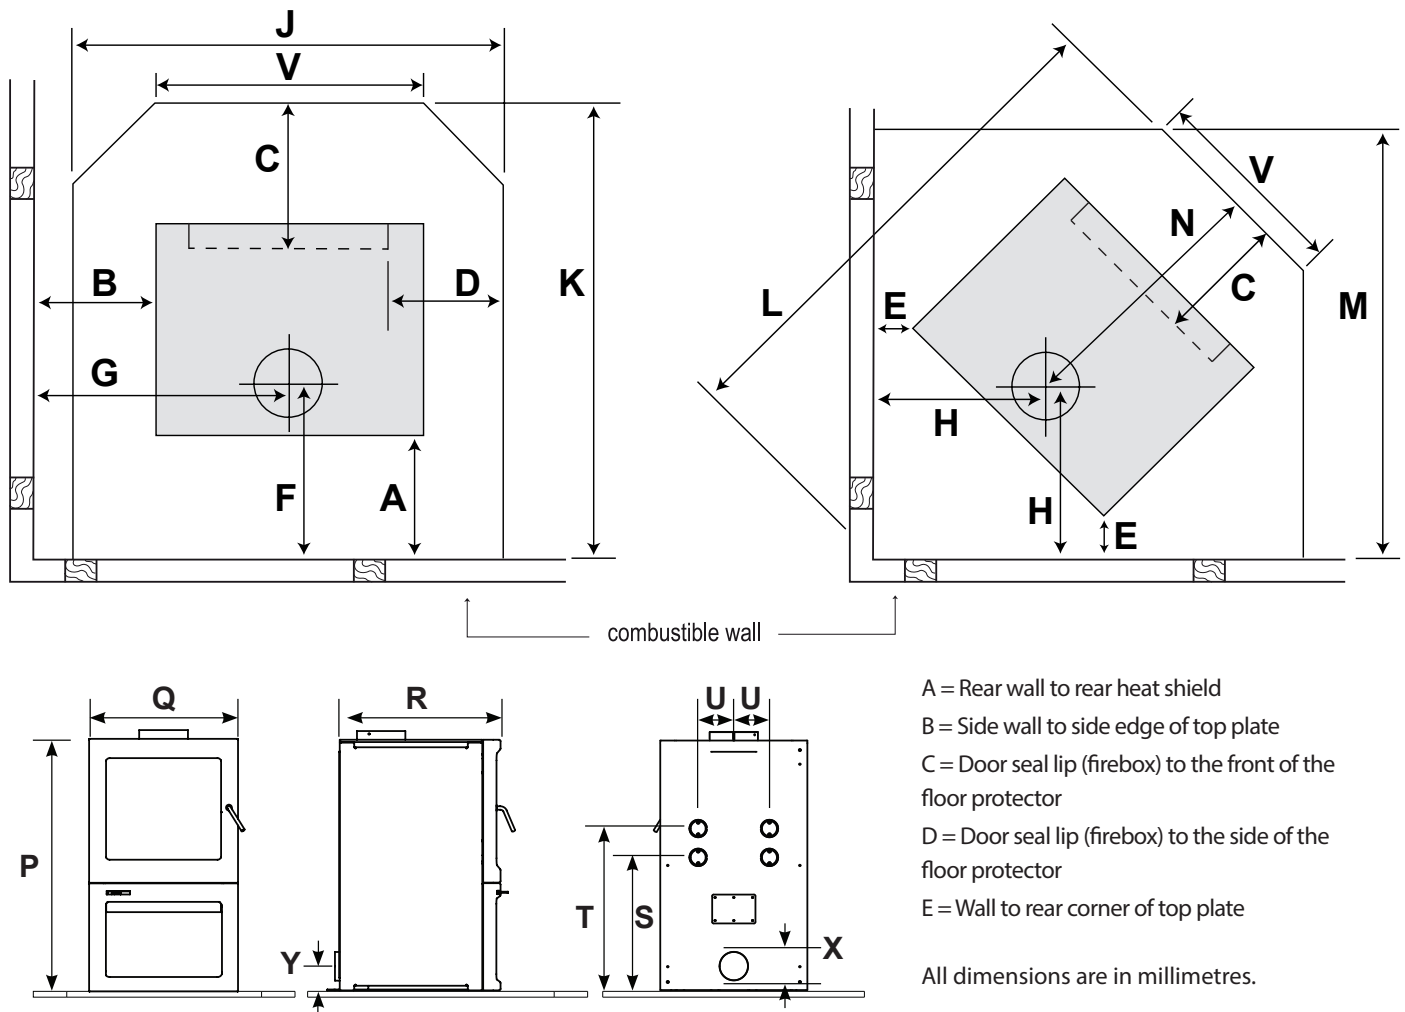

Minimum clearance requirements to combustible surface with 790mm Maxen MKIII double skin flue shield

A	B	C	D	E	F	G	H	J	K	L	M	N	P	Q	R	S	T	U	V	X	Y
100	380	300	200	130	250	635	411	800	917	1247	1024	667	865	510	556.5	460	560	123.5	400	99	83

Model	Water Heating Option	Floor Protector	ULEB Emissions	ULEB Efficiency	ULEB Emission Factor
St Clair 350-W (ULEB)	Not available	Non insulated	0.39g/kg	65%	30.6mg/MJ
St Clair 350-W (Rural)	Maxen 3.1kW	Non insulated	—	—	—


THIS APPLIANCE HAS BEEN TESTED TO AS/NZS 2918:2001 appendix B. The minimum clearance to combustible surface may be reduced if heat shielding is installed in line with AS/NZS 2918:2001.

Clean Air Authorisation Numbers:

Appliance	LEB	ULEB
St Clair 350-W	240620	240590
St Clair 350 (Rural)	NA	NA

FREESTANDING SPECIFICATIONS

PAGE 2 OF 2

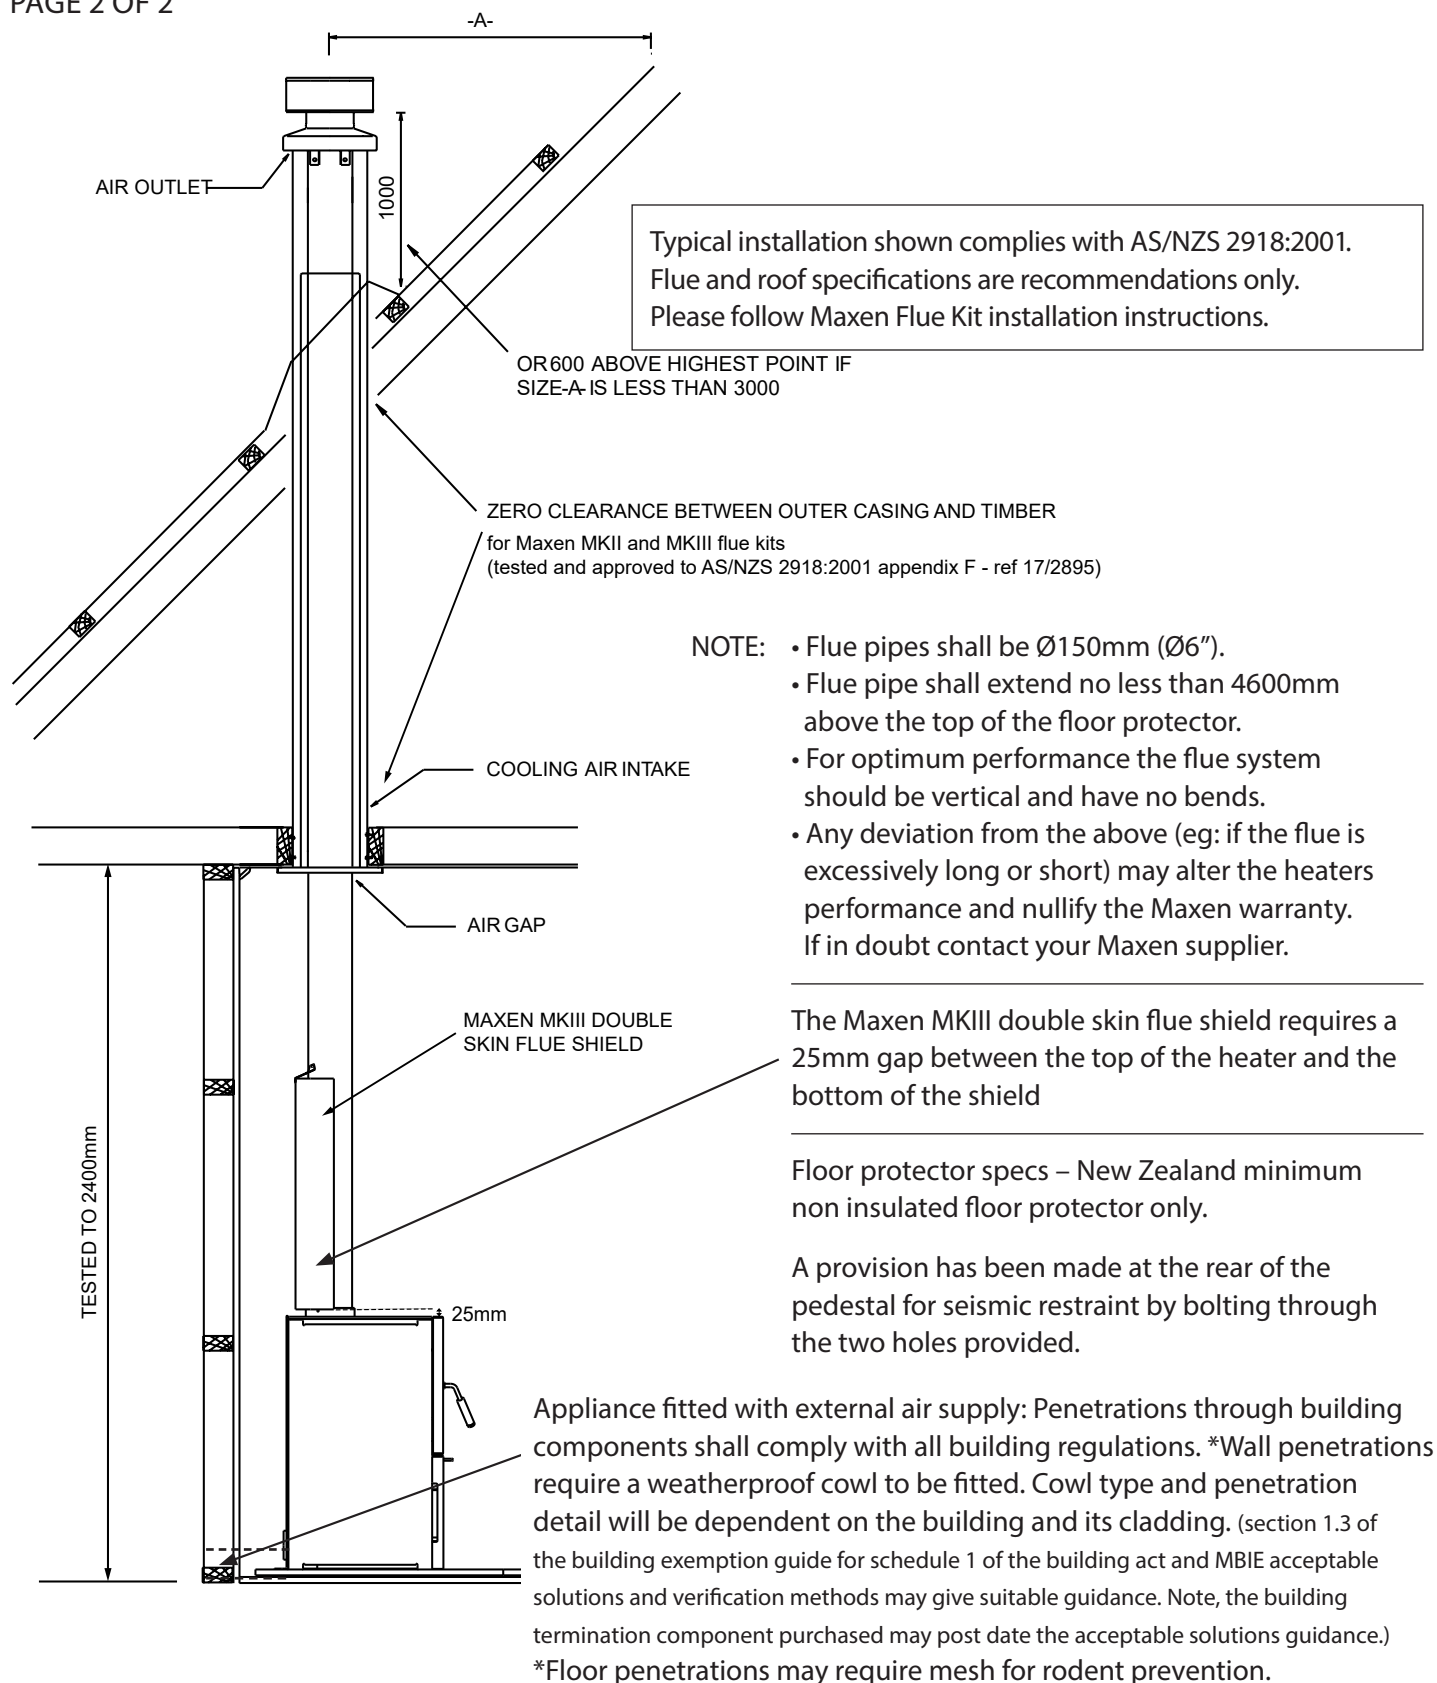

IF INSTALLED IN ACCORDANCE WITH THESE SPECIFICATIONS THE HEATER COMPLIES WITH AS/NZS 2918:2001.

MAXEN FIREPLACES RESERVE THE RIGHT TO CHANGE SPECIFICATIONS OR DESIGNS WITHOUT PRIOR NOTICE.